


REAR YARD ONLY  
(Example)

Doors shall accommodate the removal of the largest piece of equipment. (24" Min.)

Provide 1sq.in. per 1000 Btu @ the upper + lower 12" of enclosure for combustion air

Heater Clearances:  
6" Side and Back  
18" Plumbing Side  
30" In Front  
OR  
AS PER MANUFACTURERS SPECIFICATIONS

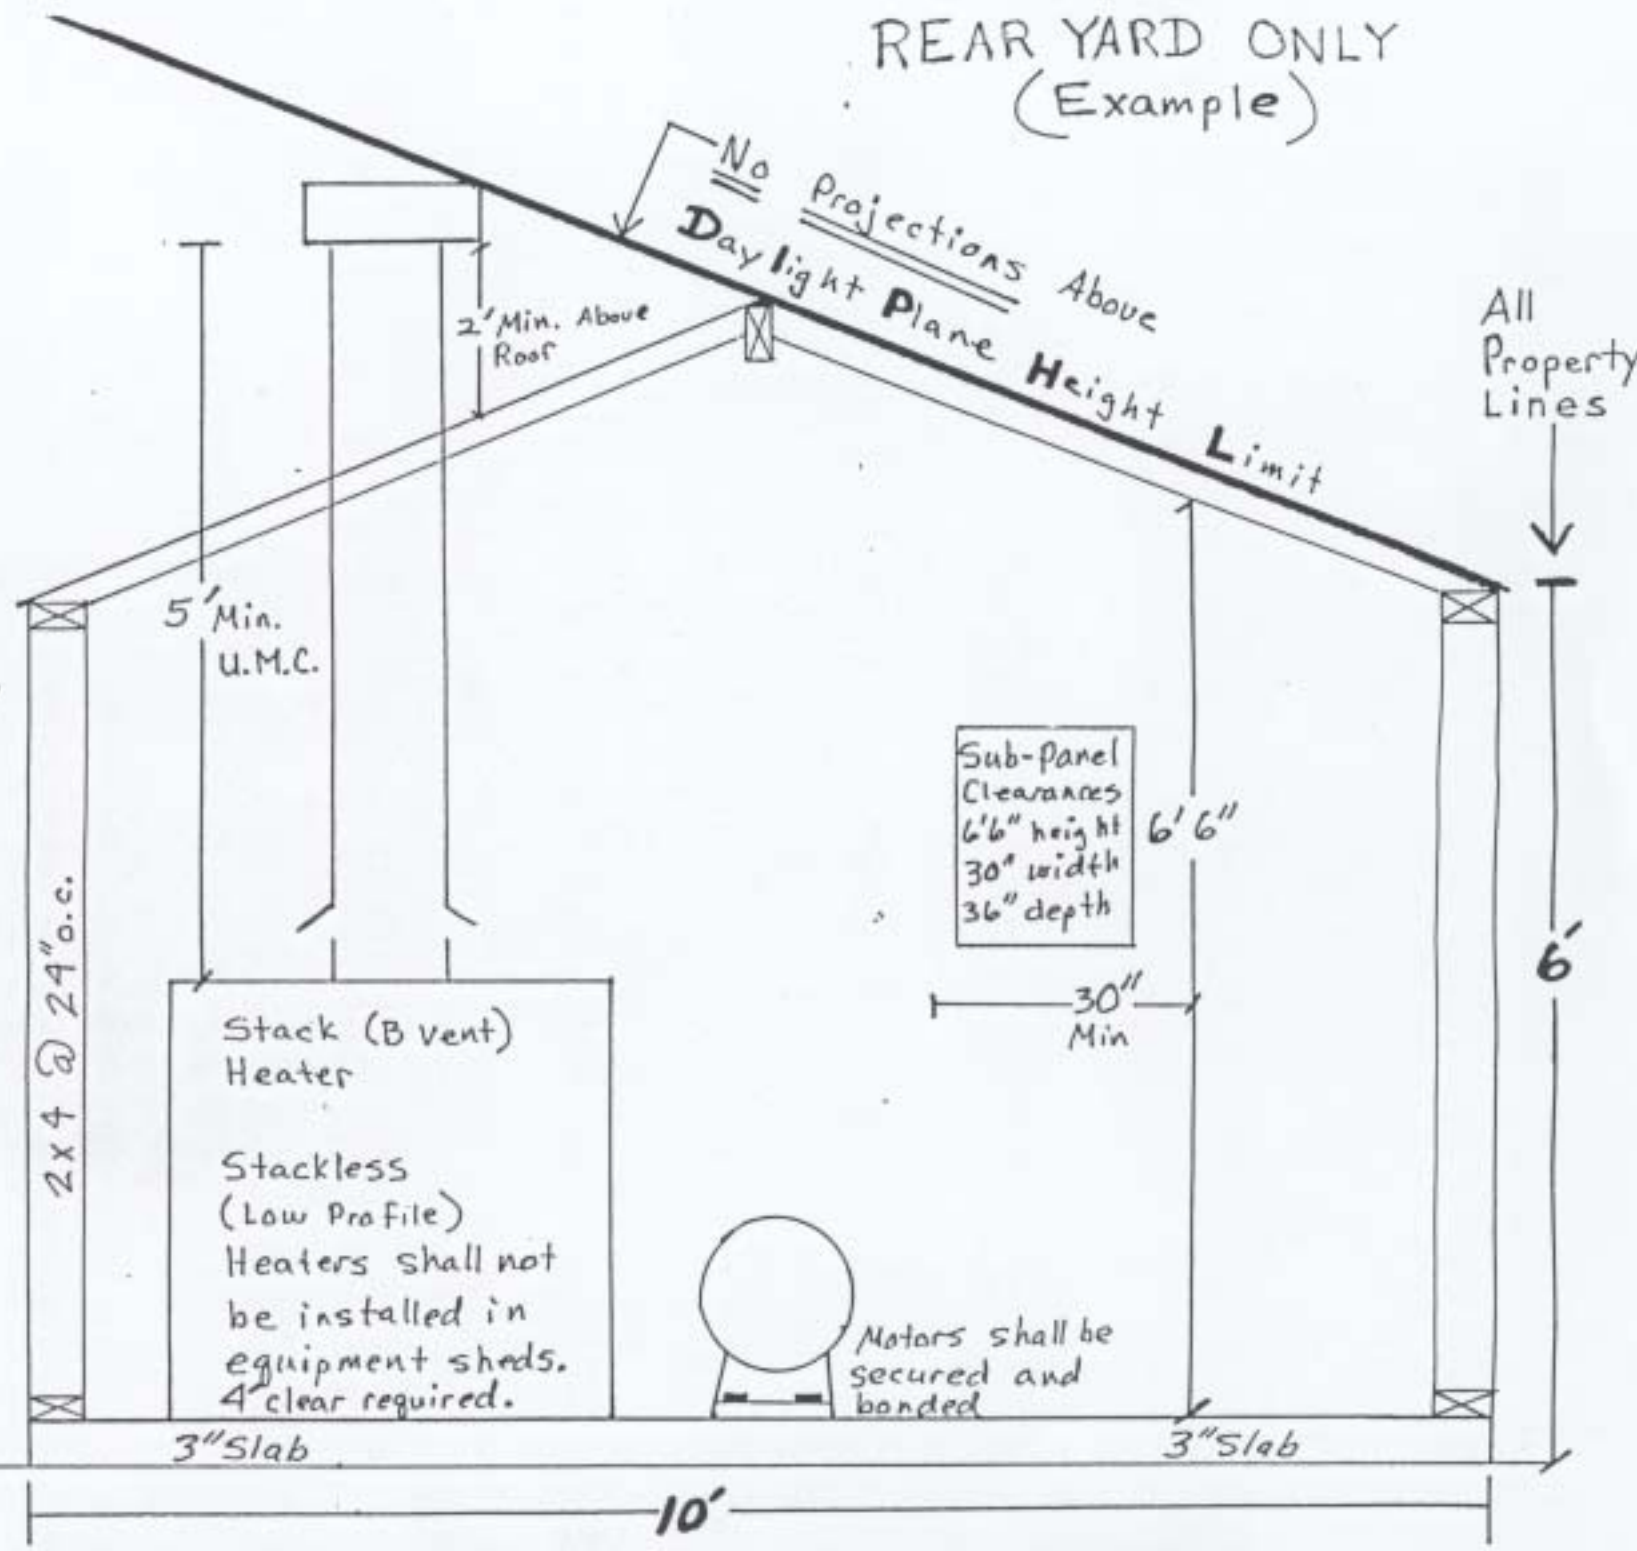

3" Slab

3" Slab

10'

6'